

Floodlight Summary:

Report based on lamp delivering 1000 lumens.

Maximum Intensity	2916.6 cd per klm.
(Luminaire orientation as tested.)	90.0 degrees vertical
	0.0 degrees horizontal

Beam Spread	At 10% of Imax	68.1V x 180.0H
	At 50% of Imax	24.6V x 132.5H
	At 90% of Imax	8.9V x 60.5H

Beam Flux	Total	950.4 lumens per klm.
	To 10% of Imax	0.0 lumens per klm.
	To 50% of Imax	0.0 lumens per klm.
	To 90% of Imax	0.0 lumens per klm.

Upward LOR	50.4 %
Downward LOR	44.6 %


Luminaire Efficiency (Light Output Ratio)	95.1 %
---	--------

C Range: 0 - 360DEG
C Interval: 5.0DEG
Test Speed: HIGH
Temperature: 25.3°C
Operators:
Test Date: 24 January 2023

γ Range: 0 - 150DEG
γ Interval: 5.0DEG
Test System: EVERFINE GO-2000A_V1 SYSTEM V2.00.456
Humidity: 65.0%
Test Distance: 6.340m [K=1.0000]
Remarks:

LUMINAIRE PHOTOMETRIC TEST REPORT

NAME: 96GRF328WW/1BL	TYPE:	WEIGHT: 1
SPEC.:	DIM.: F 160 x 90	SERIAL No.: 0
MFR.: Elmark Industries JSC	SUR.: Circle	Shielding Angle:

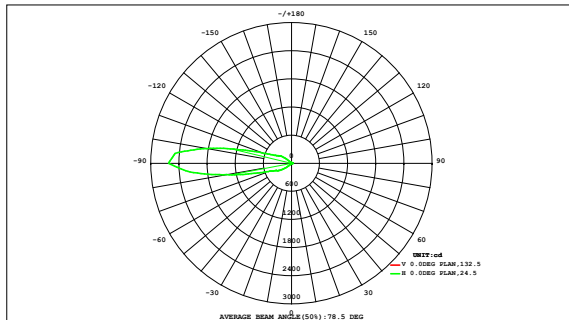

DATA OF LAMP		PHOTOMETRIC DATA	
MODEL	96GRF328WW/1BL	Imax (cd)	2625
NOMINAL POWER (W)	10	AVAILABILITY (%)	79.9
RATED VOLTAGE (V)	230	Avai. FLUX (lm)	718.9
NOMINAL FLUX (lm)	900	LOR (%)	95.1
LAMPS INSIDE	1	TOTAL FLUX (lm)	855.8
TEST VOLTAGE (V)	230	θ @50% (H,V)	132,25DEG

VERTICAL (DEG)	AREA FLUX DIAGRAM																UNIT:lm		Φ t	Φ a
	0.00	0.01	0.05	0.17	0.68	4.74	9.92	21.8	50.4	58.9	30.5	11.9	6.07	1.13	0.17	0.05	0.01	0.00	196	188
90	0.00	0.01	0.05	0.15	0.46	3.43	8.45	13.6	23.1	25.6	16.2	9.39	4.70	0.70	0.16	0.05	0.01	0.00	106	96.0
80	0.00	0.01	0.04	0.11	0.27	1.45	5.57	9.15	11.2	11.5	9.61	6.52	2.34	0.36	0.14	0.04	0.01	0.00	58.3	44.3
70	0.00	0.01	0.03	0.08	0.19	0.40	1.66	4.27	6.12	6.29	4.90	2.39	0.60	0.25	0.10	0.03	0.01	0.00	27.3	4.62
60	0.00	0.01	0.03	0.06	0.11	0.21	0.35	0.62	1.06	1.14	0.81	0.46	0.29	0.16	0.07	0.02	0.01	0.00	5.41	0.00
50	0.00	0.01	0.02	0.04	0.07	0.11	0.17	0.24	0.29	0.31	0.29	0.23	0.15	0.08	0.04	0.02	0.01	0.00	2.07	0.00
40	0.00	0.00	0.01	0.03	0.04	0.06	0.08	0.10	0.12	0.12	0.11	0.09	0.06	0.04	0.02	0.01	0.00	0.00	0.90	0.00
30	0.00	0.00	0.01	0.01	0.02	0.03	0.04	0.04	0.05	0.05	0.04	0.03	0.03	0.02	0.01	0.00	0.00	0.00	0.37	0.00
20	0.00	0.00	0.00	0.00	0.00	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.00	0.00	0.00	0.00	0.00	0.00	0.07	0.00
10	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.01	0.00
0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.03	0.00
-10	0.00	0.00	0.00	0.00	0.00	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.00	0.00	0.00	0.00	0.00	0.00	0.08	0.00
-20	0.00	0.00	0.00	0.00	0.01	0.02	0.02	0.03	0.03	0.03	0.02	0.02	0.01	0.01	0.00	0.00	0.00	0.00	0.20	0.00
-30	0.00	0.00	0.00	0.01	0.02	0.03	0.05	0.06	0.07	0.06	0.05	0.03	0.02	0.01	0.00	0.00	0.00	0.00	0.41	0.00
-40	0.00	0.00	0.00	0.01	0.03	0.05	0.08	0.11	0.12	0.12	0.09	0.06	0.03	0.02	0.01	0.00	0.00	0.00	0.73	0.00
-50	0.00	0.00	0.00	0.01	0.04	0.08	0.12	0.15	0.16	0.16	0.13	0.09	0.05	0.02	0.01	0.00	0.00	0.00	1.03	0.00
-60	0.00	0.00	0.01	0.02	0.05	0.09	0.14	0.17	0.18	0.18	0.16	0.12	0.07	0.03	0.01	0.00	0.00	0.00	1.21	0.00
-70	0.00	0.00	0.01	0.02	0.05	0.10	0.15	0.17	0.19	0.18	0.16	0.12	0.07	0.03	0.01	0.00	0.00	0.00	1.27	0.00
-80	0.00	0.00	0.01	0.02	0.05	0.10	0.15	0.17	0.19	0.18	0.16	0.12	0.07	0.03	0.01	0.00	0.00	0.00	1.27	0.00
-90	0.00	0.00	0.01	0.02	0.05	0.10	0.15	0.17	0.19	0.18	0.16	0.12	0.07	0.03	0.01	0.00	0.00	0.00	1.27	0.00
HORIZONTAL (DEG)																				
Φ t	0.01	0.07	0.26	0.73	2.04	10.8	26.8	50.5	93.1	105	63.1	31.5	14.5	2.86	0.76	0.24	0.06	0.01	402	---
Φ a	0.00	0.00	0.00	0.00	0.00	1.16	18.7	43.9	86.5	98.1	56.3	23.9	4.23	0.00	0.00	0.00	0.00	0.00	---	333

one-half-peak spread: U:11.0,D:13.8 , L:45.7,R:42.8


NEMA Beam Type: Type 7 x 4 (H x V)

C Range: 0 - 360DEG
C Interval: 5.0DEG
Test Speed: HIGH
Temperature:25.3°C
Operators:
Test Date:24 January 2023

γ Range: 0 - 150DEG
γ Interval: 5.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.456
Humidity:65.0%
Test Distance:6.340m [K=1.0000]
Remarks:

ISOCANDELA DIAGRAM

NAME: 96GRF328WW/1BL	TYPE:	WEIGHT: 1
SPEC.:	DIM.: F 160 x 90	SERIAL No.: 0
MFR.: Elmark Industries JSC	SUR.: Circle	Shielding Angle:

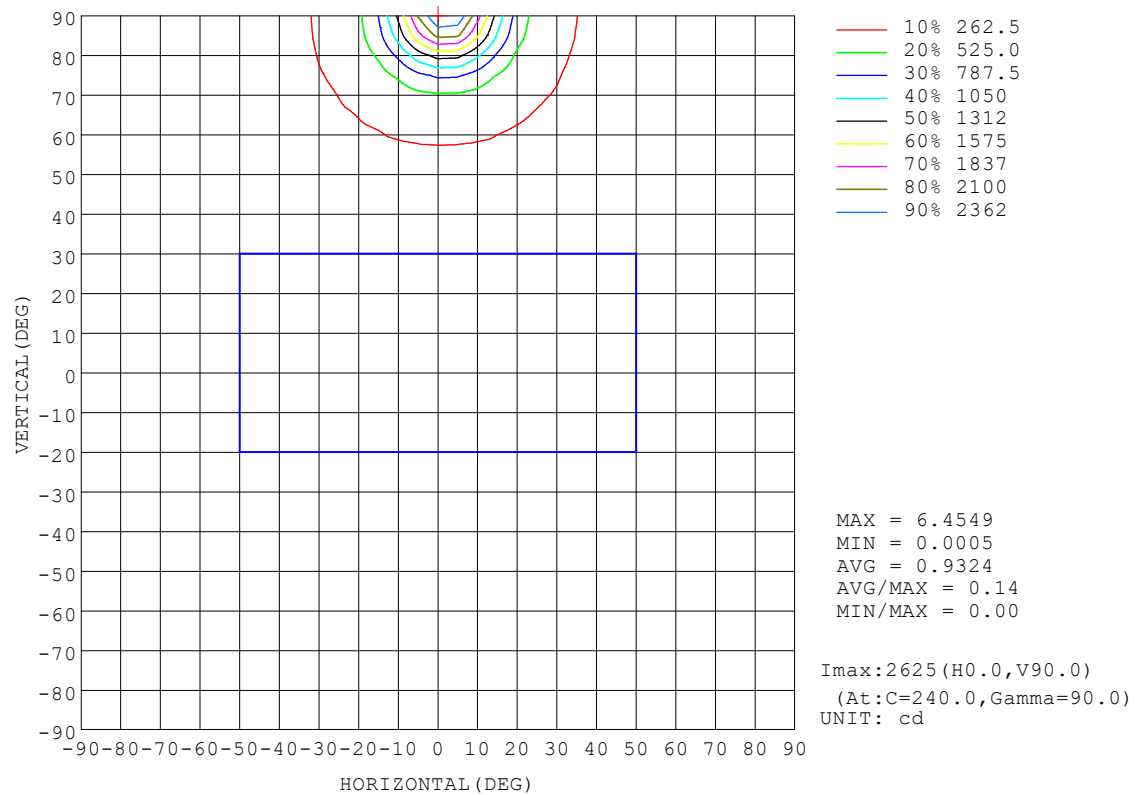


C Range: 0 - 360DEG
 C Interval: 5.0DEG
 Test Speed: HIGH
 Temperature: 25.3°C
 Operators:
 Test Date: 24 January 2023

γ Range: 0 - 150DEG
 γ Interval: 5.0DEG
 Test System: EVERFINE GO-2000A_V1 SYSTEM V2.00.456
 Humidity: 65.0%
 Test Distance: 6.340m [K=1.0000]
 Remarks:

ISOLUX DIAGRAM


NAME: 96GRF328WW/1BL	TYPE:	WEIGHT: 1
SPEC.:	DIM.: F 160 x 90	SERIAL No.: 0
MFR.: Elmark Industries JSC	SUR.: Circle	Shielding Angle:

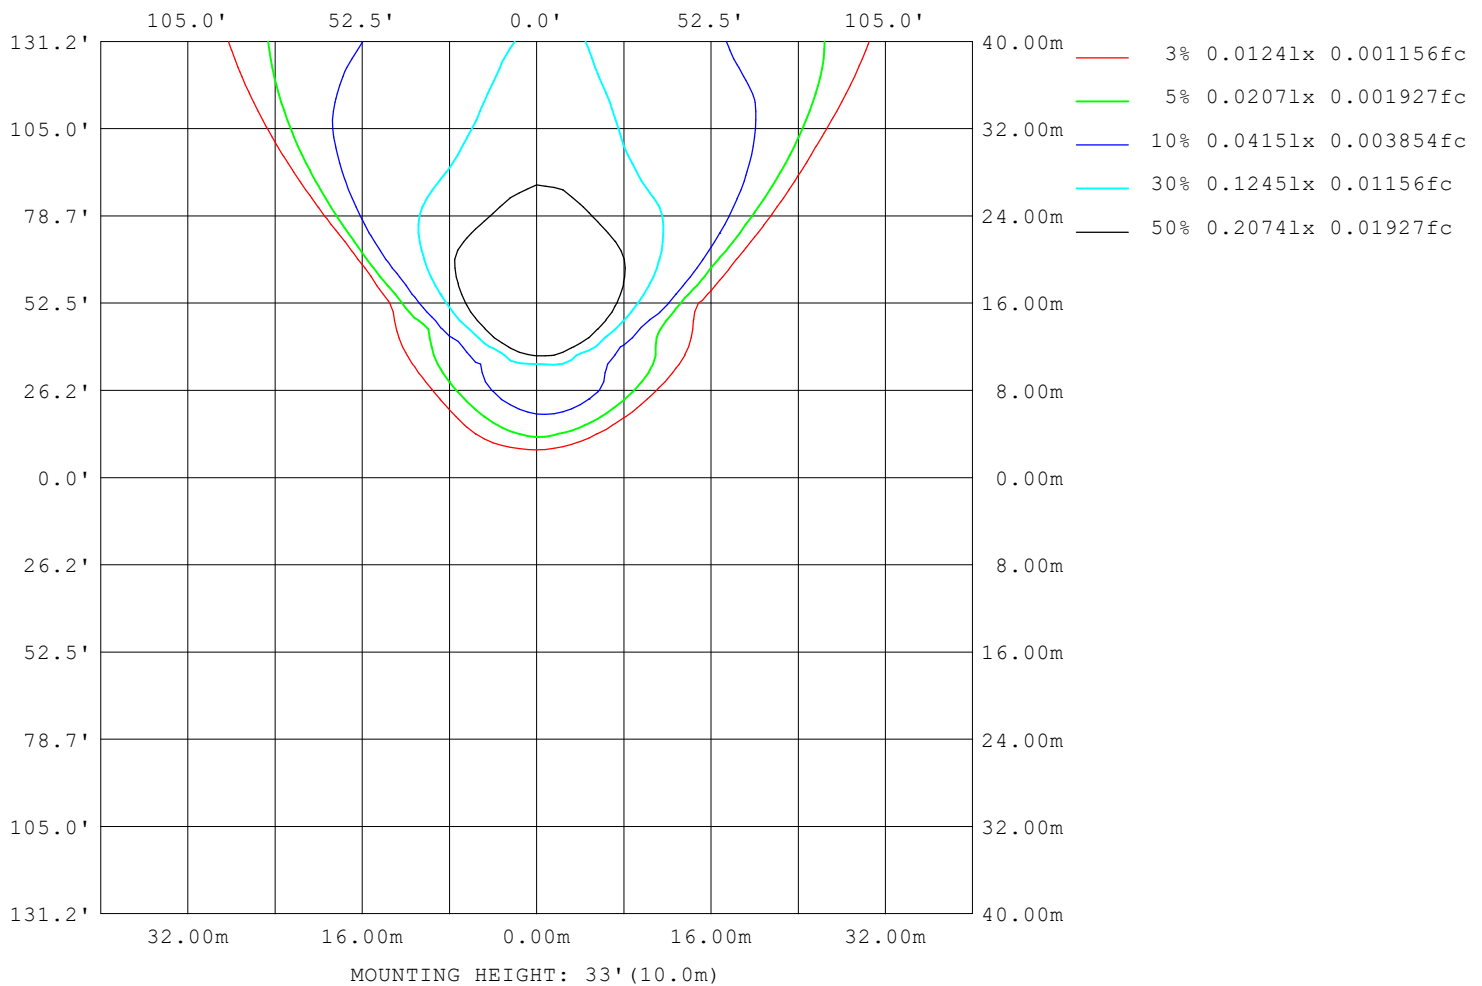

C Range: 0 - 360DEG
C Interval: 5.0DEG
Test Speed: HIGH
Temperature: 25.3°C
Operators:
Test Date: 24 January 2023

γ Range: 0 - 150DEG
γ Interval: 5.0DEG
Test System: EVERFINE GO-2000A_V1 SYSTEM V2.00.456
Humidity: 65.0%
Test Distance: 6.340m [K=1.0000]
Remarks:

Planar Illuminance Curve

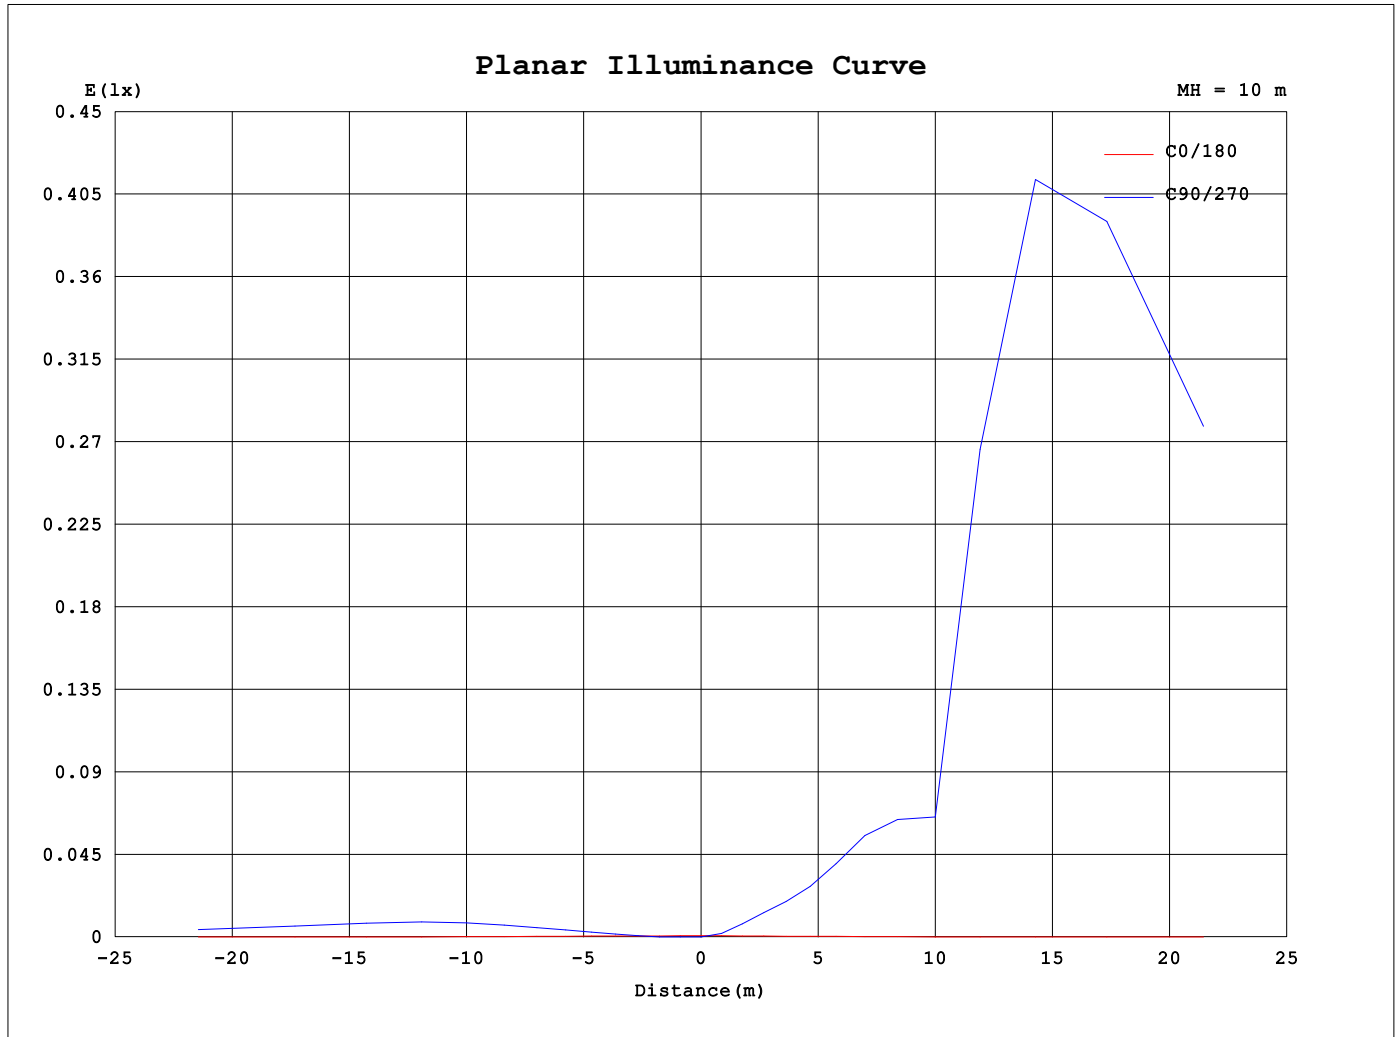


C Range: 0 - 360DEG
 C Interval: 5.0DEG
 Test Speed: HIGH
 Temperature: 25.3°C
 Operators:
 Test Date: 24 January 2023

γ Range: 0 - 150DEG
 γ Interval: 5.0DEG
 Test System: EVERFINE GO-2000A_V1 SYSTEM V2.00.456
 Humidity: 65.0%
 Test Distance: 6.340m [K=1.0000]
 Remarks:

AAI Figure

NAME: 96GRF328WW/1BL	TYPE:	WEIGHT: 1
SPEC.:	DIM.: F 160 x 90	SERIAL No.: 0
MFR.: Elmark Industries JSC	SUR.: Circle	Shielding Angle:

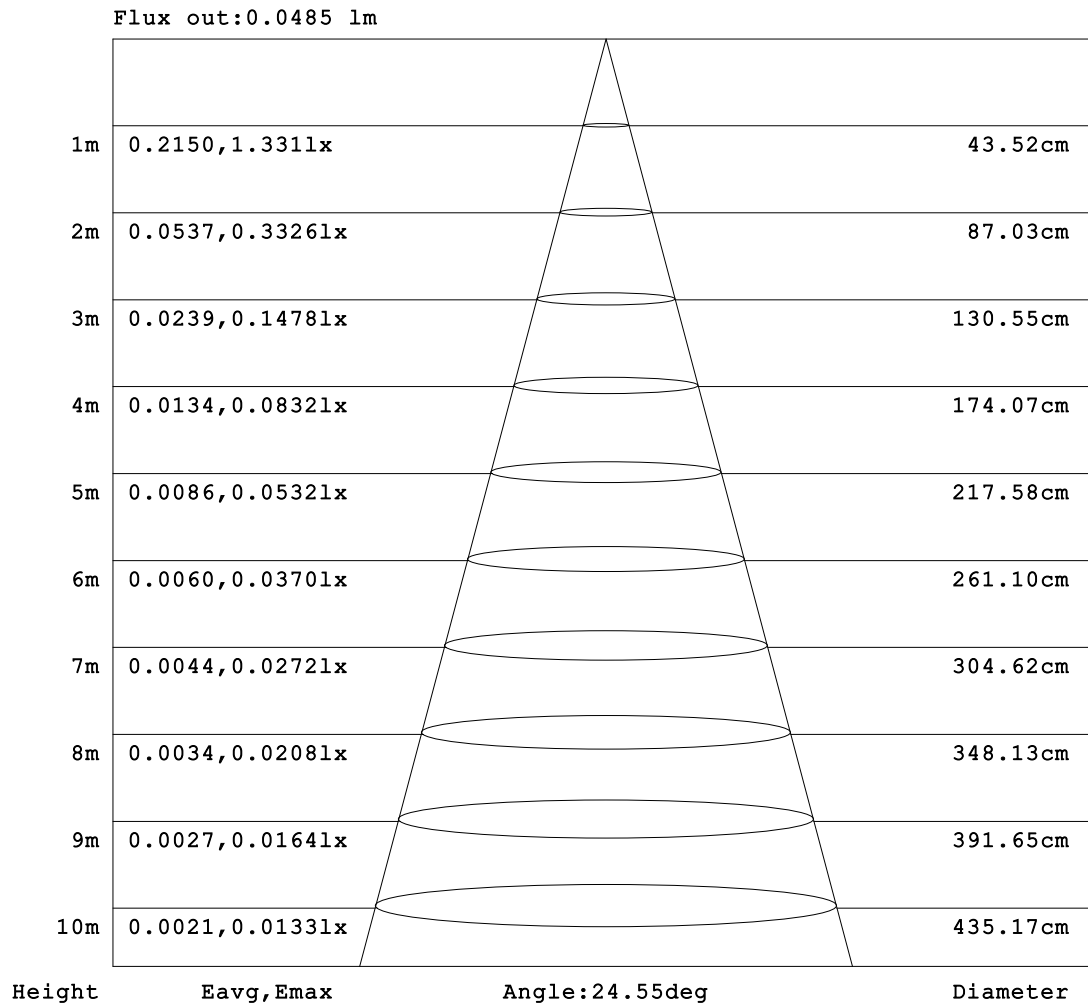

Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG
 C Interval: 5.0DEG
 Test Speed: HIGH
 Temperature:25.3°C
 Operators:
 Test Date:24 January 2023

γ Range: 0 - 150DEG
 γ Interval: 5.0DEG
 Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.456
 Humidity:65.0%
 Test Distance:6.340m [K=1.0000]
 Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

NAME: 96GRF328WW/1BL	TYPE:	WEIGHT: 1
SPEC.:	DIM.: F 160 x 90	SERIAL No.: 0
MFR.: Elmark Industries JSC	SUR.: Circle	Shielding Angle:

Table--1

UNIT: cd

H (DEG) V (DEG)	-90	-85	-80	-75	-70	-65	-60	-55	-50	-45	-40	-35	-30	-25	-20	-15	-10	-5	0
-180	0.01	0.01	0.01	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-170	0.01	0.01	0.02	0.02	0.02	0.03	0.03	0.04	0.05	0.05	0.05	0.04	0.05	0.02	0.00	0.00	0.00	0.00	0.00
-160	0.01	0.02	0.02	0.03	0.04	0.05	0.06	0.07	0.08	0.11	0.12	0.12	0.15	0.15	0.11	0.00	0.00	0.00	0.00
-150	0.01	0.02	0.03	0.04	0.06	0.08	0.12	0.17	0.20	0.25	0.31	0.32	0.39	0.41	0.44	0.47	0.49	0.48	0.45
-140	0.01	0.02	0.04	0.05	0.09	0.15	0.23	0.29	0.39	0.48	0.58	0.68	0.78	0.86	0.94	0.96	0.94	0.88	0.81
-130	0.01	0.03	0.04	0.07	0.13	0.24	0.33	0.47	0.62	0.80	1.01	1.25	1.48	1.69	1.86	1.95	1.93	1.82	1.64
-120	0.01	0.03	0.05	0.09	0.19	0.31	0.46	0.66	0.90	1.24	1.65	2.12	2.56	2.96	3.26	3.40	3.31	2.97	2.53
-110	0.01	0.03	0.05	0.11	0.23	0.37	0.58	0.85	1.24	1.77	2.42	3.08	3.69	4.18	4.52	4.61	4.44	4.03	3.61
-100	0.01	0.03	0.05	0.12	0.25	0.42	0.67	0.98	1.51	2.19	3.03	3.80	4.49	4.98	5.31	5.41	5.34	5.15	5.04
-90	0.01	0.03	0.05	0.13	0.26	0.44	0.69	1.05	1.63	2.40	3.31	4.14	4.84	5.33	5.71	5.91	6.04	6.06	6.10
-80	0.01	0.03	0.05	0.12	0.25	0.43	0.67	1.03	1.55	2.31	3.16	4.02	4.71	5.27	5.66	5.98	6.16	6.28	6.24
-70	0.01	0.03	0.05	0.11	0.22	0.39	0.60	0.91	1.34	1.95	2.69	3.46	4.15	4.73	5.16	5.49	5.69	5.81	5.80
-60	0.01	0.03	0.05	0.10	0.19	0.32	0.50	0.71	1.01	1.41	1.95	2.54	3.16	3.70	4.14	4.46	4.68	4.80	4.79
-50	0.01	0.03	0.04	0.08	0.14	0.23	0.37	0.51	0.70	0.93	1.22	1.56	1.93	2.30	2.64	2.88	3.04	3.11	3.10
-40	0.01	0.03	0.04	0.05	0.10	0.16	0.23	0.34	0.44	0.56	0.70	0.83	0.99	1.15	1.27	1.40	1.47	1.47	1.44
-30	0.01	0.02	0.03	0.04	0.05	0.10	0.14	0.17	0.24	0.31	0.35	0.43	0.47	0.53	0.57	0.60	0.61	0.61	0.59
-20	0.01	0.02	0.03	0.03	0.04	0.04	0.06	0.09	0.11	0.12	0.14	0.18	0.18	0.21	0.22	0.21	0.23	0.23	0.20
-10	0.01	0.02	0.02	0.03	0.03	0.03	0.03	0.03	0.03	0.03	0.04	0.06	0.05	0.04	0.06	0.05	0.05	0.04	0.01
0	0.01	0.02	0.02	0.02	0.03	0.03	0.03	0.04	0.04	0.05	0.05	0.05	0.06	0.06	0.06	0.07	0.07	0.07	0.07
10	0.01	0.05	0.08	0.11	0.13	0.15	0.22	0.33	0.42	0.50	0.58	0.64	0.69	0.75	0.74	0.76	0.75	0.77	0.76
20	0.01	0.08	0.14	0.21	0.44	0.65	0.86	1.05	1.25	1.45	1.62	1.77	1.93	2.02	2.13	2.21	2.29	2.35	2.35
30	0.01	0.11	0.20	0.53	0.86	1.19	1.52	1.88	2.18	2.49	2.80	3.11	3.54	4.02	4.50	5.04	5.54	5.89	6.17
40	0.01	0.13	0.38	0.81	1.27	1.74	2.23	2.66	3.21	3.93	4.83	6.00	7.38	8.92	10.5	11.8	12.9	13.8	14.3
50	0.01	0.15	0.54	1.07	1.64	2.28	2.89	3.76	4.98	6.69	8.81	11.1	13.4	15.7	31.1	50.6	75.1	92.7	100
60	0.01	0.17	0.67	1.29	2.00	2.77	3.78	5.36	7.62	10.5	13.4	22.5	57.9	125	191	246	285	306	312
70	0.01	0.19	0.77	1.46	2.27	3.22	4.82	7.36	10.5	13.5	29.0	93.1	186	270	324	366	416	468	498
80	0.01	0.19	0.82	1.56	2.44	3.58	5.70	9.03	12.6	16.0	64.8	171	275	334	406	557	840	1190	1412
90	0.01	0.20	0.84	1.60	2.50	3.78	6.24	10.0	13.7	17.6	86.9	204	301	356	476	793	1369	2126	2625
100	0.01	0.19	0.82	1.57	2.45	3.76	6.25	9.98	13.6	17.3	74.3	180	283	339	420	628	1014	1496	1841
110	0.01	0.18	0.76	1.47	2.29	3.50	5.65	8.94	12.5	15.5	40.1	112	206	283	333	384	465	559	635
120	0.01	0.17	0.66	1.29	2.03	2.99	4.56	6.98	10.2	13.3	16.9	32.4	87.1	159	223	274	304	319	328
130	0.01	0.15	0.53	1.06	1.65	2.30	3.32	4.84	6.97	9.52	12.0	13.8	16.7	27.1	56.1	89.8	120	141	154
140	0.01	0.13	0.38	0.77	1.25	1.74	2.26	3.00	4.03	5.35	6.88	8.52	10.1	11.3	12.3	12.9	13.9	14.4	13.6
150	0.01	0.10	0.20	0.50	0.79	1.15	1.49	1.82	2.23	2.69	3.16	3.70	4.33	4.96	5.46	5.98	6.28	6.34	6.27
160	0.01	0.07	0.14	0.22	0.41	0.58	0.77	0.98	1.17	1.33	1.51	1.67	1.79	1.94	1.38	0.00	0.00	0.00	0.00
170	0.01	0.04	0.07	0.10	0.12	0.15	0.20	0.27	0.33	0.38	0.45	0.52	0.57	0.26	0.00	0.00	0.00	0.00	0.00
180	0.01	0.01	0.01	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

C Range: 0 - 360DEG
C Interval: 5.0DEG
Test Speed: HIGH
Temperature:25.3°C
Operators:
Test Date:24 January 2023

γ Range: 0 - 150DEG
γ Interval: 5.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.456
Humidity:65.0%
Test Distance:6.340m [K=1.0000]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

NAME: 96GRF328WW/1BL	TYPE:	WEIGHT: 1
SPEC.:	DIM.: F 160 x 90	SERIAL No.: 0
MFR.: Elmark Industries JSC	SUR.: Circle	Shielding Angle:

Table--2

UNIT: cd

H(DEC) V(DEC)	5	10	15	20	25	30	35	40	45	50	55	60	65	70	75	80	85	90	
-180	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.01	0.01	0.01	0.01	0.02	0.02	0.03	0.03	
-170	0.00	0.00	0.00	0.00	0.00	0.01	0.01	0.01	0.02	0.01	0.01	0.00	0.00	0.00	0.01	0.02	0.02	0.03	
-160	0.00	0.00	0.00	0.04	0.03	0.04	0.02	0.02	0.03	0.01	0.01	0.02	0.02	0.01	0.00	0.01	0.02	0.03	
-150	0.39	0.32	0.25	0.19	0.15	0.14	0.11	0.11	0.07	0.06	0.05	0.03	0.02	0.03	0.02	0.01	0.02	0.03	
-140	0.69	0.56	0.48	0.42	0.35	0.32	0.28	0.24	0.20	0.16	0.10	0.08	0.04	0.03	0.04	0.02	0.02	0.03	
-130	1.38	1.16	1.00	0.84	0.75	0.64	0.55	0.46	0.37	0.29	0.21	0.13	0.09	0.04	0.04	0.03	0.01	0.03	
-120	2.10	1.85	1.71	1.60	1.45	1.23	1.02	0.79	0.61	0.44	0.33	0.21	0.13	0.07	0.04	0.03	0.01	0.03	
-110	3.28	3.12	3.03	2.89	2.59	2.17	1.70	1.26	0.90	0.64	0.43	0.29	0.16	0.09	0.03	0.04	0.01	0.03	
-100	4.89	4.79	4.62	4.31	3.80	3.14	2.39	1.73	1.16	0.80	0.52	0.35	0.19	0.10	0.04	0.04	0.01	0.03	
-90	5.91	5.73	5.44	5.06	4.45	3.71	2.82	2.02	1.32	0.88	0.56	0.37	0.20	0.10	0.04	0.04	0.01	0.03	
-80	6.10	5.84	5.53	5.06	4.46	3.65	2.79	1.95	1.31	0.85	0.56	0.35	0.20	0.10	0.04	0.04	0.01	0.03	
-70	5.69	5.43	5.08	4.56	3.91	3.13	2.36	1.66	1.13	0.75	0.50	0.31	0.18	0.09	0.05	0.04	0.01	0.03	
-60	4.67	4.40	4.00	3.48	2.87	2.24	1.65	1.19	0.83	0.60	0.39	0.25	0.14	0.08	0.05	0.04	0.02	0.03	
-50	2.96	2.73	2.42	2.06	1.66	1.31	1.00	0.76	0.56	0.41	0.28	0.19	0.09	0.05	0.05	0.03	0.02	0.03	
-40	1.38	1.29	1.14	0.97	0.83	0.68	0.55	0.44	0.34	0.24	0.18	0.10	0.07	0.05	0.05	0.03	0.02	0.03	
-30	0.57	0.53	0.48	0.44	0.38	0.30	0.27	0.19	0.17	0.12	0.08	0.06	0.06	0.06	0.04	0.02	0.02	0.03	
-20	0.20	0.18	0.15	0.14	0.12	0.09	0.10	0.08	0.07	0.06	0.06	0.06	0.05	0.04	0.03	0.03	0.02	0.03	
-10	0.03	0.03	0.03	0.05	0.06	0.06	0.06	0.07	0.07	0.06	0.05	0.04	0.03	0.03	0.03	0.03	0.03	0.03	
0	0.07	0.07	0.07	0.07	0.07	0.07	0.07	0.07	0.06	0.06	0.06	0.05	0.05	0.04	0.04	0.03	0.03	0.03	
10	0.76	0.73	0.71	0.66	0.64	0.58	0.52	0.47	0.40	0.35	0.28	0.20	0.14	0.13	0.11	0.08	0.06	0.03	
20	2.37	2.33	2.19	2.10	1.96	1.81	1.61	1.45	1.26	1.07	0.89	0.71	0.53	0.37	0.19	0.13	0.08	0.03	
30	6.38	6.40	6.15	5.62	5.09	4.44	3.76	3.13	2.55	2.06	1.65	1.30	0.99	0.70	0.44	0.18	0.11	0.03	
40	14.4	14.3	13.8	13.3	12.2	10.7	8.77	6.90	5.24	3.83	2.76	2.01	1.49	1.05	0.65	0.33	0.13	0.03	
50	100	89.0	70.4	49.0	23.2	17.5	14.3	12.2	9.49	6.78	4.57	3.01	2.00	1.38	0.88	0.45	0.15	0.03	
60	309	294	263	220	164	98.7	38.1	18.2	13.2	9.95	6.72	4.29	2.68	1.72	1.07	0.55	0.16	0.03	
70	492	448	391	343	298	234	142	58.1	16.1	12.1	8.66	5.50	3.24	1.97	1.21	0.62	0.17	0.03	
80	1381	1088	752	488	369	311	231	116	24.6	13.0	9.71	6.19	3.57	2.13	1.29	0.67	0.18	0.03	
90	2567	1943	1192	673	425	337	266	145	33.0	13.1	9.87	6.33	3.69	2.18	1.33	0.68	0.18	0.03	
100	1764	1375	893	557	392	320	242	123	25.4	12.2	9.10	5.92	3.52	2.11	1.30	0.66	0.18	0.03	
110	624	550	451	373	318	255	161	65.8	15.1	10.6	7.67	5.07	3.13	1.95	1.21	0.62	0.17	0.03	
120	327	317	294	256	197	120	44.9	17.3	10.7	8.15	5.79	3.92	2.57	1.70	1.07	0.55	0.16	0.03	
130	145	127	99.4	65.0	31.0	16.8	11.3	9.27	7.31	5.49	3.96	2.78	1.93	1.38	0.87	0.45	0.15	0.03	
140	13.9	13.0	11.6	10.5	9.23	7.92	6.58	5.34	4.22	3.27	2.49	1.89	1.46	1.04	0.63	0.33	0.13	0.03	
150	6.06	5.72	5.26	4.68	4.19	3.64	3.13	2.66	2.28	1.90	1.55	1.27	0.97	0.66	0.43	0.19	0.10	0.03	
160	0.00	0.00	0.00	1.28	1.81	1.65	1.52	1.35	1.18	1.03	0.85	0.66	0.50	0.36	0.21	0.13	0.08	0.03	
170	0.00	0.00	0.00	0.00	0.25	0.55	0.50	0.43	0.36	0.32	0.27	0.21	0.17	0.14	0.11	0.08	0.05	0.03	
180	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.01	0.01	0.01	0.01	0.02	0.02	0.03	0.03	

C Range: 0 - 360DEG
C Interval: 5.0DEG
Test Speed: HIGH
Temperature:25.3°C
Operators:
Test Date:24 January 2023

γ Range: 0 - 150DEG
γ Interval: 5.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.456
Humidity:65.0%
Test Distance:6.340m [K=1.0000]
Remarks: